



DIMENSIONS FOR DROP INLET			
PIPE	MIN. H	W	W ₁
18"	4'-4"	2'-0"	2'-0"
24"	5'-0"	2'-6"	2'-6"
30"	5'-6"	3'-1"	3'-1"
36"	6'-0"	3'-8"	3'-8"

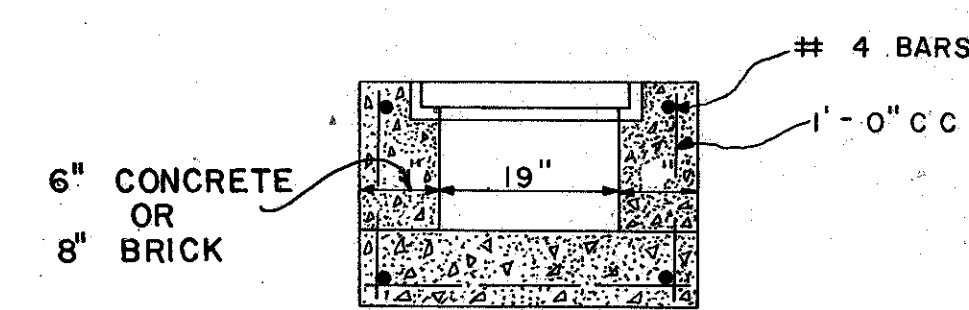


SECTION B-B


CURB MAY BE OMITTED TO FIT FIELD CONDITIONS

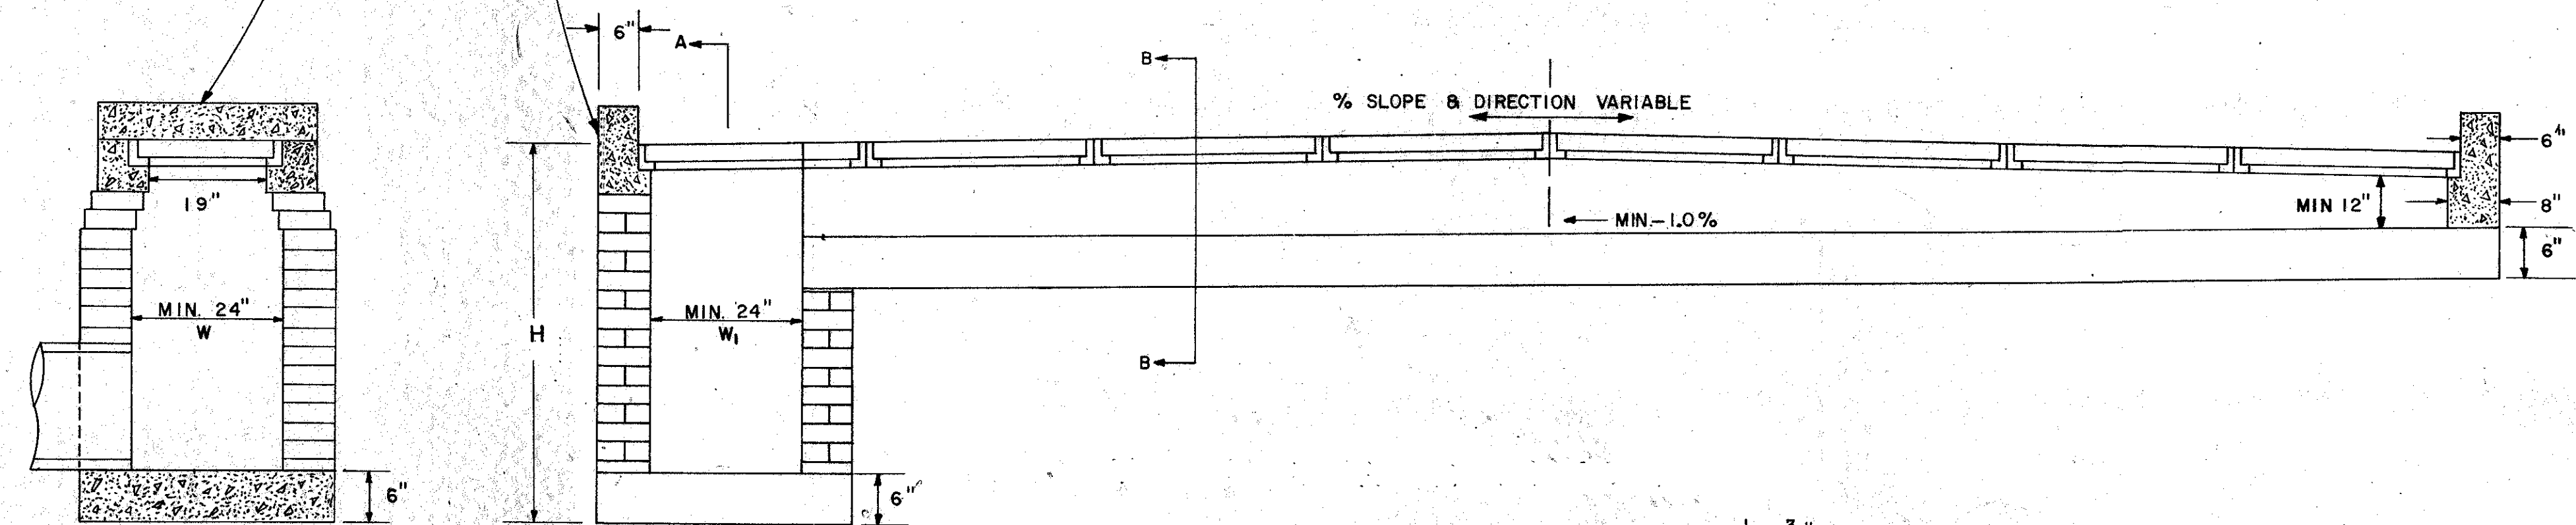

SECTION A-A

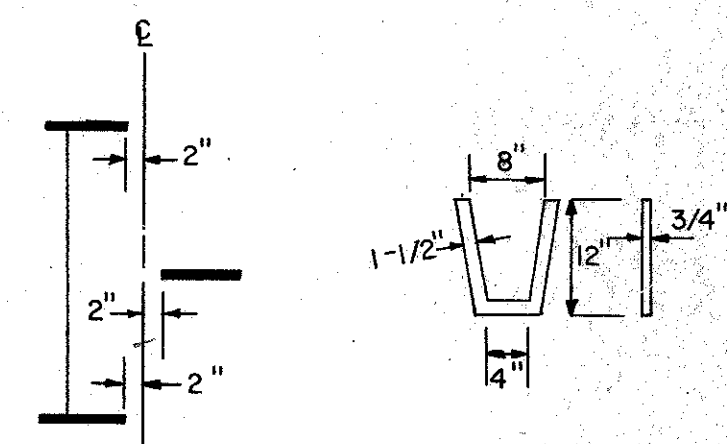

CAST IRON STEPS
NUMBER AND LOCATION OF STEPS WILL BE AS DIRECTED BY ENGINEER. AN ALTERNATE STEP MAY BE SUBSTITUTED IF APPROVED BY THE LABORATORY.

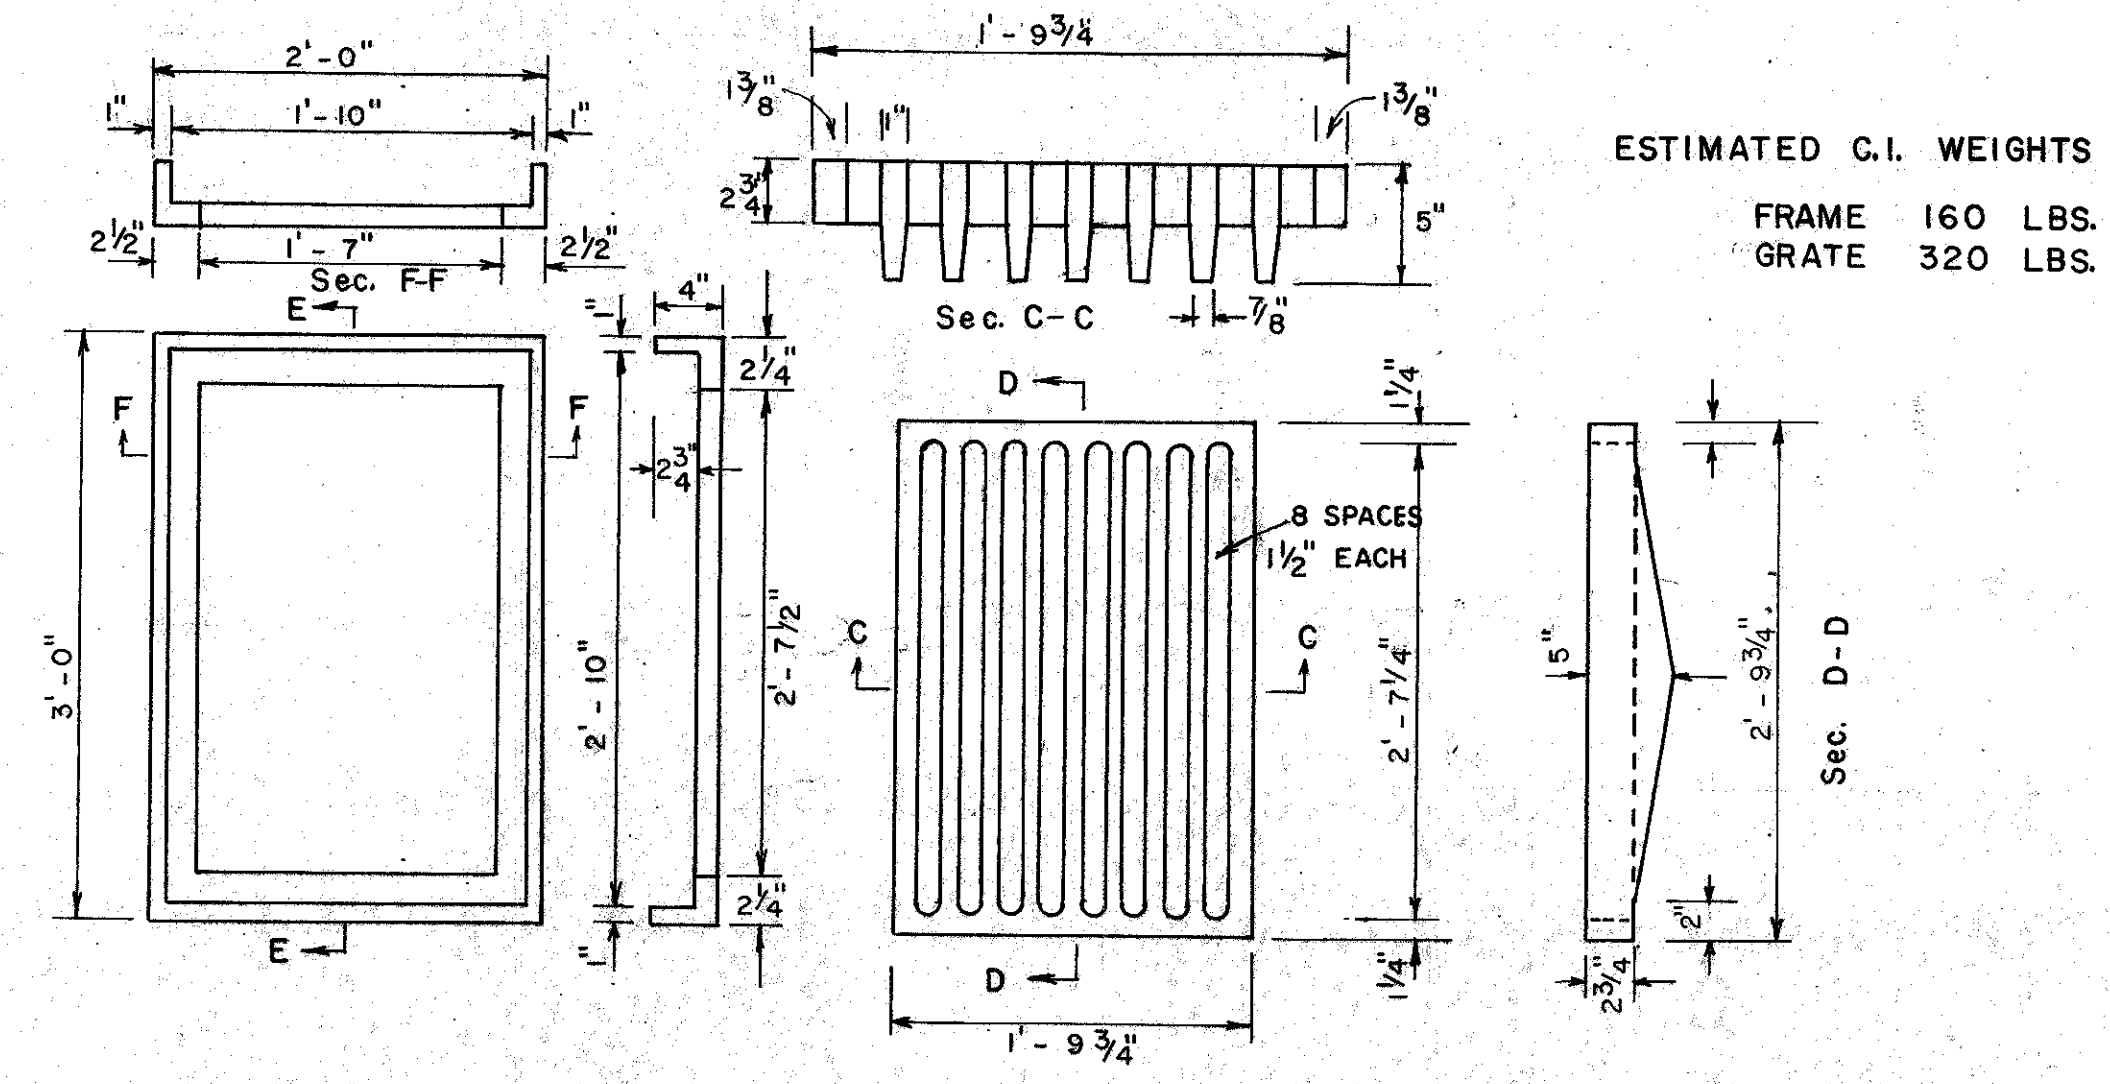

CITY OF ATLANTA TYPE B GRATE AND FRAME

CONSTRUCTION DETAILS
SPECIAL DESIGN GRATE INLET FOR DRIVEWAYS